

United Hook & Ladder Company


New Oxford, PA

This report was generated on 2/1/2025 2:41:55 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 01/01/2025 | End Date: 01/31/2025

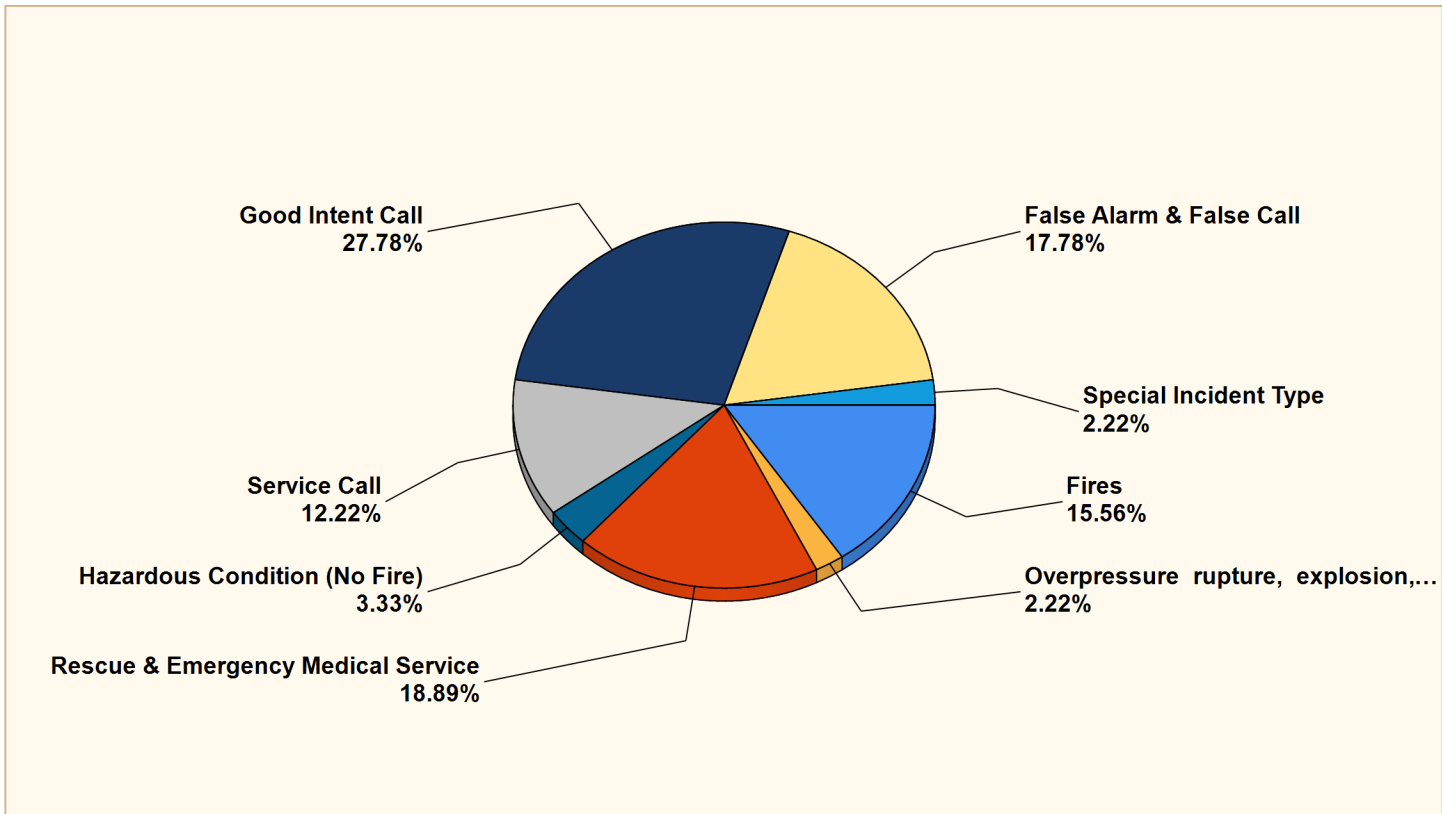

| MAJOR INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|--|-------------|-------------|
| Fires | 14 | 15.56% |
| Overpressure rupture, explosion, overheating - no fire | 2 | 2.22% |
| Rescue & Emergency Medical Service | 17 | 18.89% |
| Hazardous Condition (No Fire) | 3 | 3.33% |
| Service Call | 11 | 12.22% |
| Good Intent Call | 25 | 27.78% |
| False Alarm & False Call | 16 | 17.78% |
| Special Incident Type | 2 | 2.22% |
| TOTAL | 90 | 100% |

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



Detailed Breakdown by Incident Type

| INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|--|-------------|-------------|
| 111 - Building fire | 8 | 8.89% |
| 114 - Chimney or flue fire, confined to chimney or flue | 3 | 3.33% |
| 118 - Trash or rubbish fire, contained | 1 | 1.11% |
| 131 - Passenger vehicle fire | 1 | 1.11% |
| 132 - Road freight or transport vehicle fire | 1 | 1.11% |
| 251 - Excessive heat, scorch burns with no ignition | 2 | 2.22% |
| 311 - Medical assist, assist EMS crew | 8 | 8.89% |
| 322 - Motor vehicle accident with injuries | 6 | 6.67% |
| 324 - Motor vehicle accident with no injuries. | 3 | 3.33% |
| 412 - Gas leak (natural gas or LPG) | 1 | 1.11% |
| 424 - Carbon monoxide incident | 2 | 2.22% |
| 551 - Assist police or other governmental agency | 11 | 12.22% |
| 600 - Good intent call, other | 1 | 1.11% |
| 611 - Dispatched & cancelled en route | 19 | 21.11% |
| 651 - Smoke scare, odor of smoke | 3 | 3.33% |
| 652 - Steam, vapor, fog or dust thought to be smoke | 1 | 1.11% |
| 671 - HazMat release investigation w/no HazMat | 1 | 1.11% |
| 700 - False alarm or false call, other | 1 | 1.11% |
| 721 - Bomb scare - no bomb | 1 | 1.11% |
| 731 - Sprinkler activation due to malfunction | 2 | 2.22% |
| 733 - Smoke detector activation due to malfunction | 5 | 5.56% |
| 735 - Alarm system sounded due to malfunction | 3 | 3.33% |
| 743 - Smoke detector activation, no fire - unintentional | 1 | 1.11% |
| 744 - Detector activation, no fire - unintentional | 1 | 1.11% |
| 745 - Alarm system activation, no fire - unintentional | 2 | 2.22% |
| 900 - Special type of incident, other | 2 | 2.22% |
| TOTAL INCIDENTS: | 90 | 100% |

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.

